


Duct Sealing Performed For:	
<p>AEROSEAL CASE ID:</p> <p>SYSTEM DESCRIPTION: Batiment G</p> <p>SEAL DESCRIPTION: Alimentation section 3</p> <p>HARDWARE: Gen2</p> <p>TECHNICIAN:</p>	
<p>DATE: 6/4/2024</p>	

Overall Sealing Results:
<p>BEFORE SERVICE</p> <p>604.3 CFM of Leakage, equivalent to a 49.7 Square Inch Hole or 36% of the system capacity of 1671.0 CFM</p>
<p>AFTER SERVICE</p> <p>30.2 CFM of Leakage, equivalent to a 2.5 Square Inch Hole or 1.8% of system capacity</p>
<p>This corresponds to a 95% Reduction in Duct Leakage</p>
<p>NOTE: Duct leakage results are calculated in Cubic Feet per Minute (CFM) measured at a STANDARD OPERATING PRESSURE of 0.4 wg.</p>

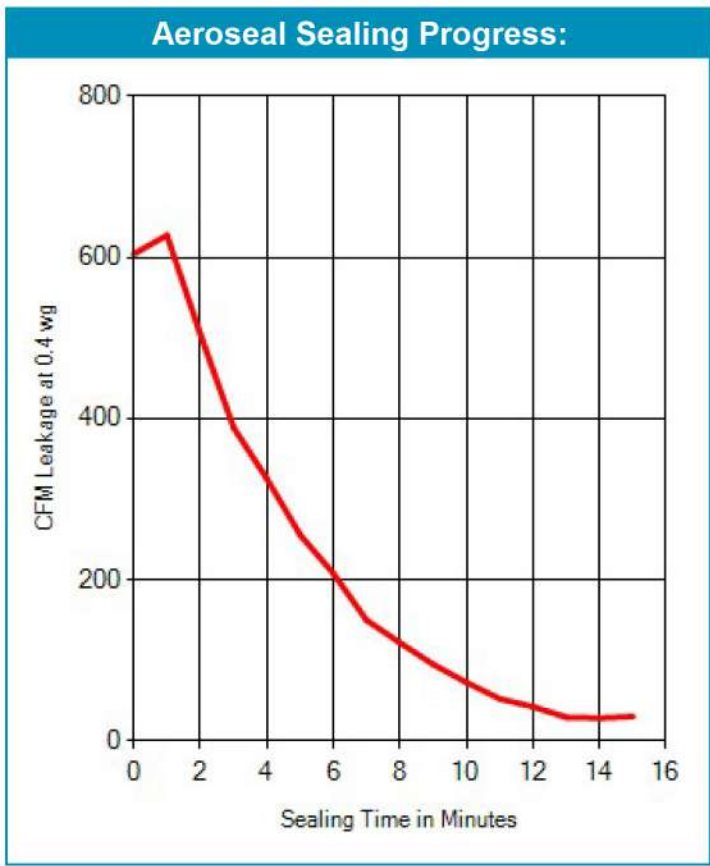

Duct Sealing Performed By:	
	<p>Le Groupe Environ-Air 325 rue Fichet Quebec, QC G1C 6Y1 Phone: 418-666-1253</p>

Aeroseal process uses DuctSeal sealant that is certified to meet requirements listed in UL 1381 standard-“Outline of investigation for Aerosol Duct Sealant” Please provide Aeroseal feedback at <http://bit.ly/2021aeroseal> and reference code **KKWRQRQ**.